
CAUTION - FAN
GENERAC


CAUTION - FAN
CAUTION - FAN
GENERA
6 AMP-12V
BATTERY
CHARGER

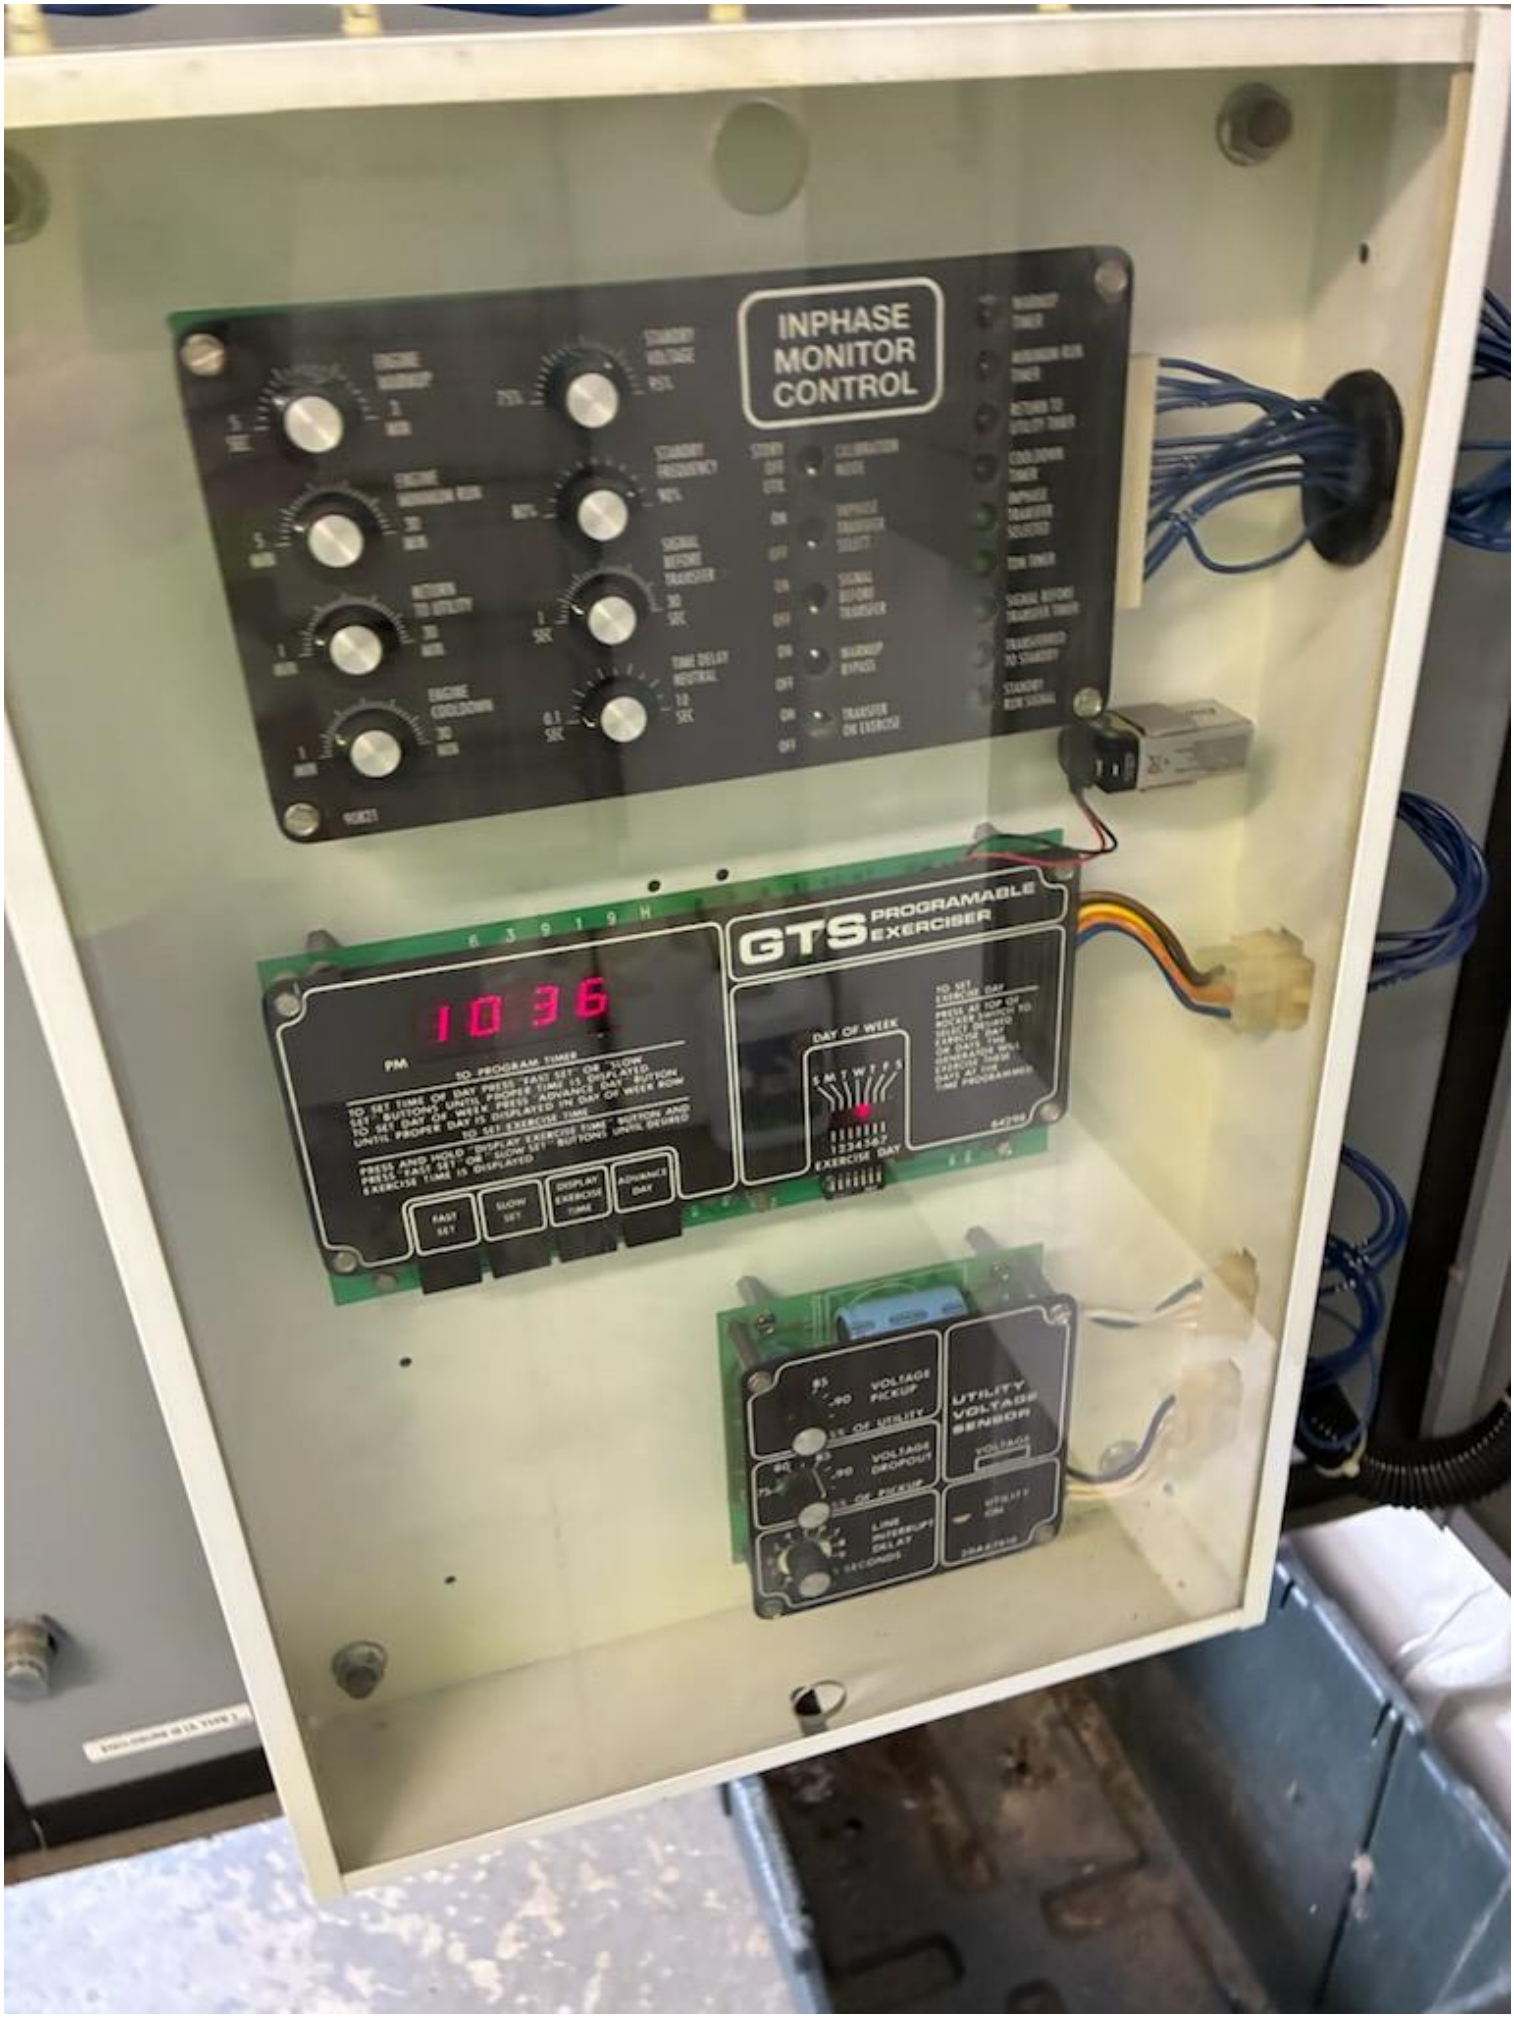

ALTERNATOR DATA
MODEL 95A00361-S
SERIAL 2018255
VOLTS 120/240
AMPS 166.66
POWER FACTOR 1.0
K.V.A. 40
PHASE 1
HERTZ 60
R.P.M. 1800
KW 20
CLASS F WINDING INSULATION AT 40° C
GENERAC CORP.
WAUKESHA, WIS.
MADE IN U.S.A.

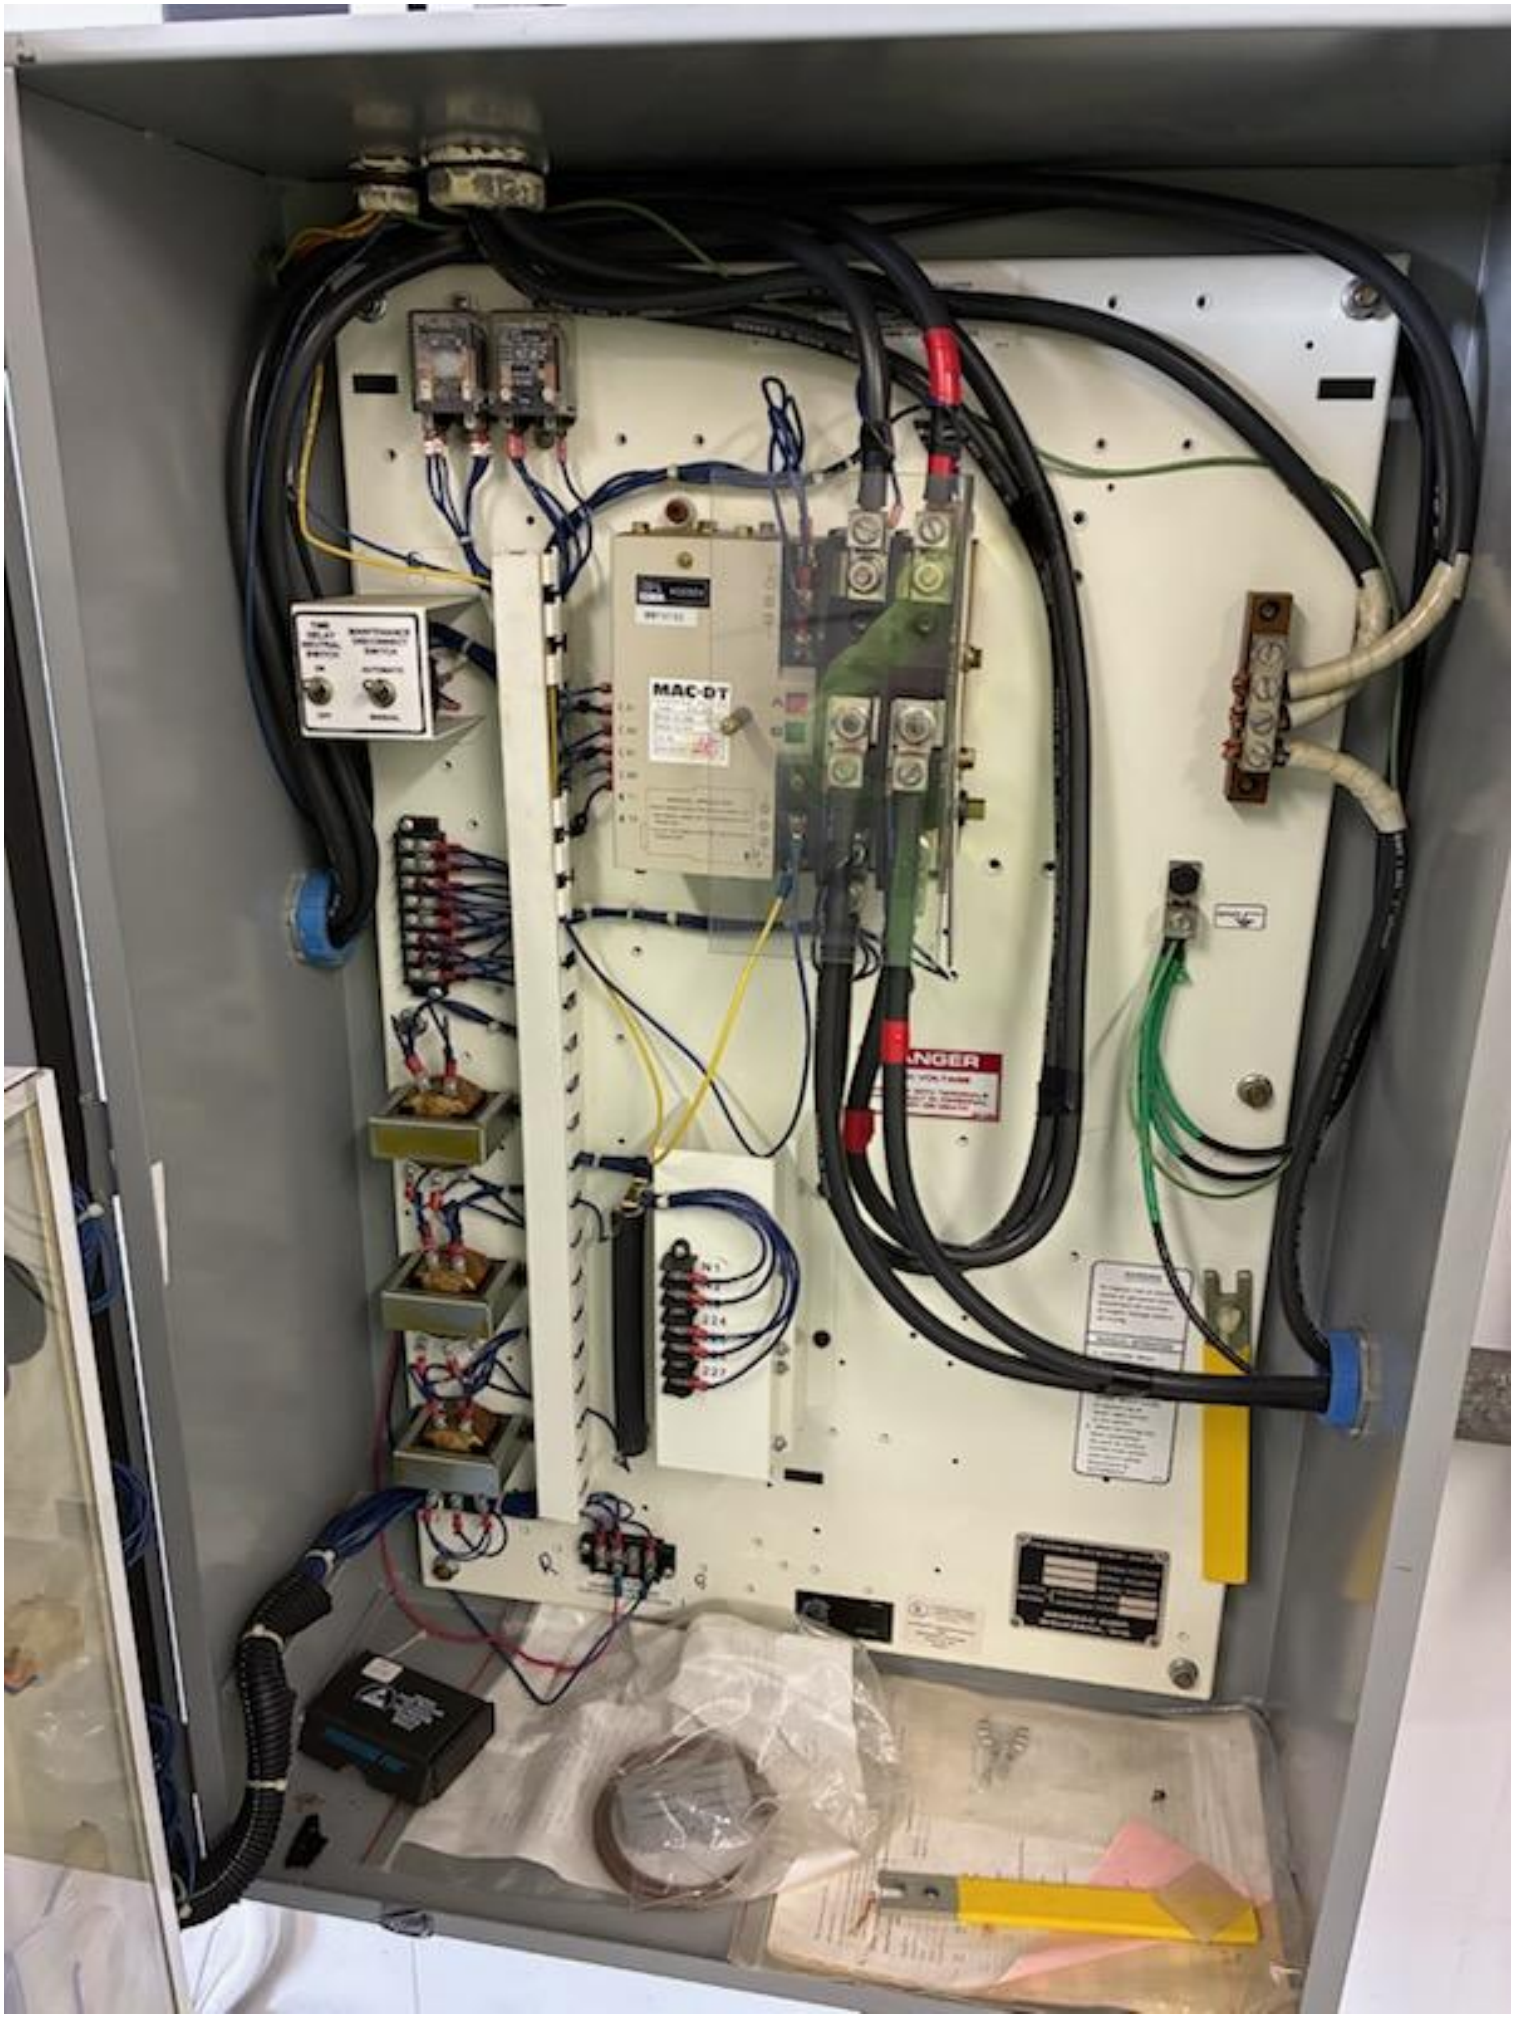

NOT IN AUTOMATIC START MODE
OVER CRANK
HIGH COOL. TEMP.
OVER SPEED
LOW OIL PRESS
TEST RESET
RPM SENSOR LOSS
V
A
Hz
TEMP
OIL
Amps
QUARTZ
TOTAL HOURS
PREHEAT
START
STOP
AUTO
MANUAL
OFF
FUSE 15-A.
INCREASE
ADJUST
PREALARM LOW OIL PRESS.
PREALARM HIGH COOL TEMP.
LOW COOL TEMP.
ALARM HORN ON-OFF
HIGH BATT. VOLTAGE
LOW BATT. VOLTAGE
RUPTURE BASIN FILLING
LOW FUEL
CIRCUIT BREAKER OPEN


CAUTION - FAN
CAUTION - FAN


CAUTION - FAN
CAUTION - FAN


CAUTION - FAN
WARNING
CAUTION - FAN


INPHASE
MONITOR
CONTROL
GTS PROGRAMABLE EXERCISER
10 36
PM
DAY OF WEEK
S M T W T F S
1 2 3 4 5 6 7
EXERCISE DAY
FAST SET
SLOW SET
DISPLAY EXERCISE TIME
ADVANCE DAY
UTILITY VOLTAGE SENSOR
VOLTAGE PICKUP
VOLTAGE DROPOUT
LINE INTERRUPT DELAY


MAC-DT


GENERAC
GTS SYSTEM
NORMAL TEST MODE
AUTOMATIC MODE
FAST TEST MODE
SYSTEM TEST
OPERATING
STAND BY
EMERGENCY
UTILITY
SWITCH POSITION
DynaTech
15 Minute
717.274.8899


FAN BELT
2450
NAPA
7450
29"
CAUTION - FAN

Westinghouse
Pittsburgh
Spitfire
E.F.D.
MADE IN U.S.A.
7
TOP
29"
pull
inside
CAUTION